



DATE OF SYNCHRONISATION				PERFORMANCE DATA							Date of commercial run					
UNIT-1	26.09.84	UNIT-4	29.01.89									UNIT-1	10.01.85	UNIT-4	01.08.89	
UNIT-2	29.03.85	UNIT-5	29.03.89									UNIT-2	01.10.85	UNIT-5	29.09.92	
UNIT-3	31.03.85	UNIT-6	30.03.93									UNIT-3	25.09.88	UNIT-6	14.12.93	
YEAR	Gen.	Total	Spec.oil	Spec.coal	Auxiliary	DM Water	Thermal	Station	N.C.V.	No.of	PAF	Coal	Coal	PLF	Gen.Cost	Gen.Cost
	Targets	Gen.	consump.	consump.	consump.	consump.	efficiency	Heat Rate		Trippings		receipt	consump.		gen. end	bus bar
	MUs	MUs	MI/Kwh	Kg/kwh	%age	%age	%age	Kcal/kwh	Kcal/kwh	Nos.	%age	Lac.Tons	Lac. Tons	%age	paise/kwh	paise/kwh
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12

GGSSTP ROPAR
PLANT LOAD FACTOR %age

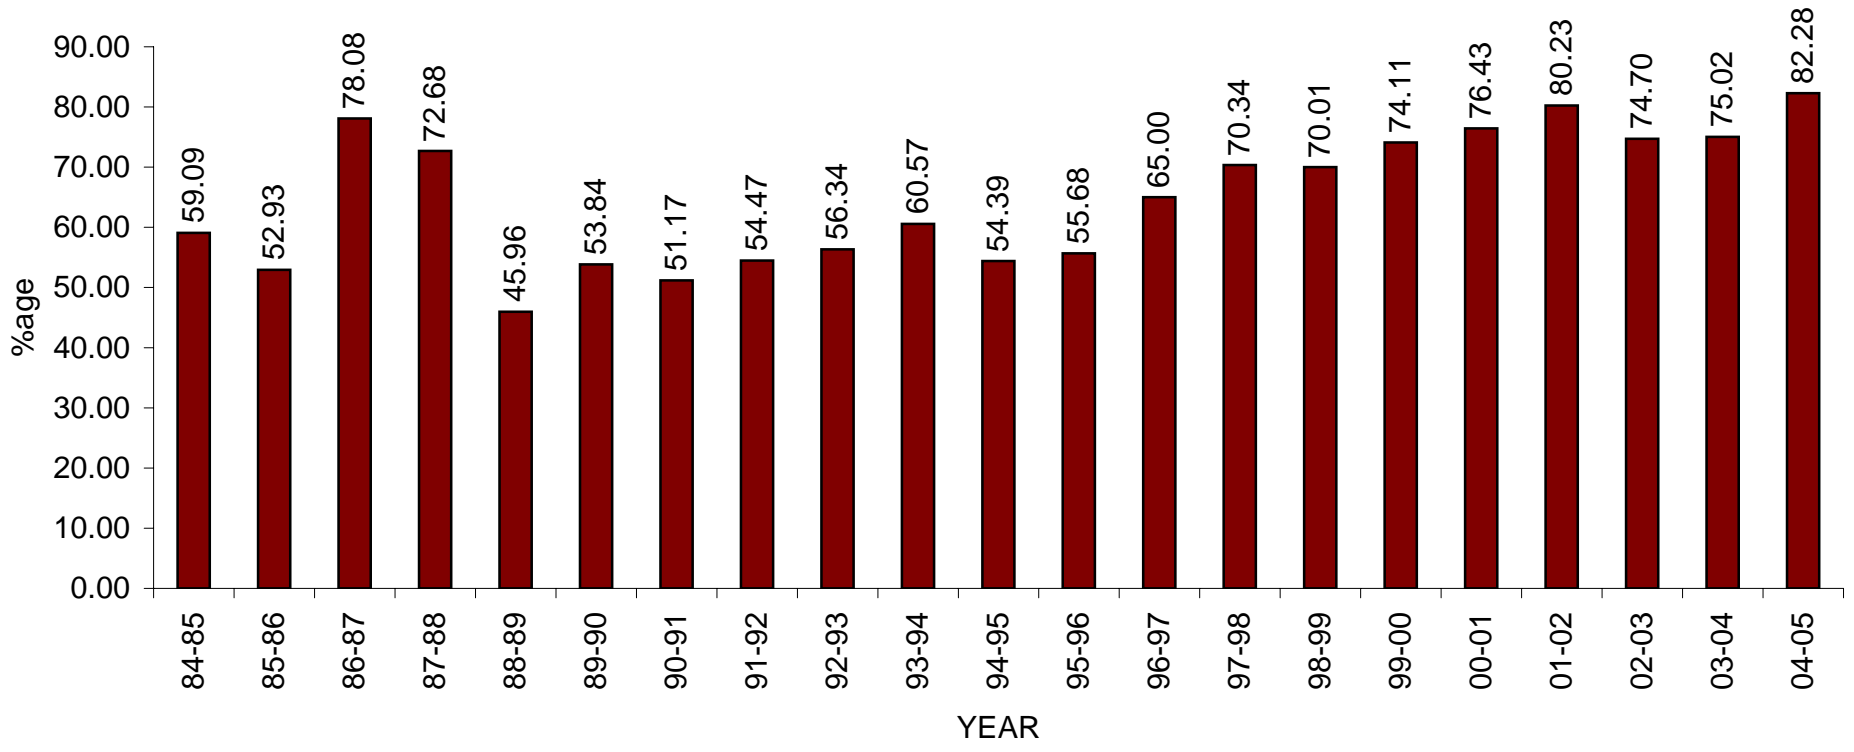


DATE OF SYNCHRONISATION				PERFORMANCE DATA							Date of commercial run					
UNIT-1	26.09.84	UNIT-4	29.01.89								UNIT-1	10.01.85	UNIT-4	01.08.89		
UNIT-2	29.03.85	UNIT-5	29.03.89								UNIT-2	01.10.85	UNIT-5	29.09.92		
UNIT-3	31.03.85	UNIT-6	30.03.93								UNIT-3	25.09.88	UNIT-6	14.12.93		
YEAR	Gen.	Total	Spec.oil	Spec.coal	Auxiliary	DM Water	Thermal	Station	N.C.V.	No.of	PAF	Coal	Coal	PLF	Gen.Cost	Gen.Cost
	Targets	Gen.	consump.	consump.	consump.	consump.	efficiency	Heat Rate		Trippings		receipt	consump.		gen. end	bus bar
	MUs	MUs	MI/Kwh	Kg/kwh	%age	%age	%age	Kcal/kwh	Kcal/kwh	Nos.	%age	Lac.Tons	Lac. Tons	%age	paise/kwh	paise/kwh
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12

GGSSSTP ROPAR
TRIPPINGS

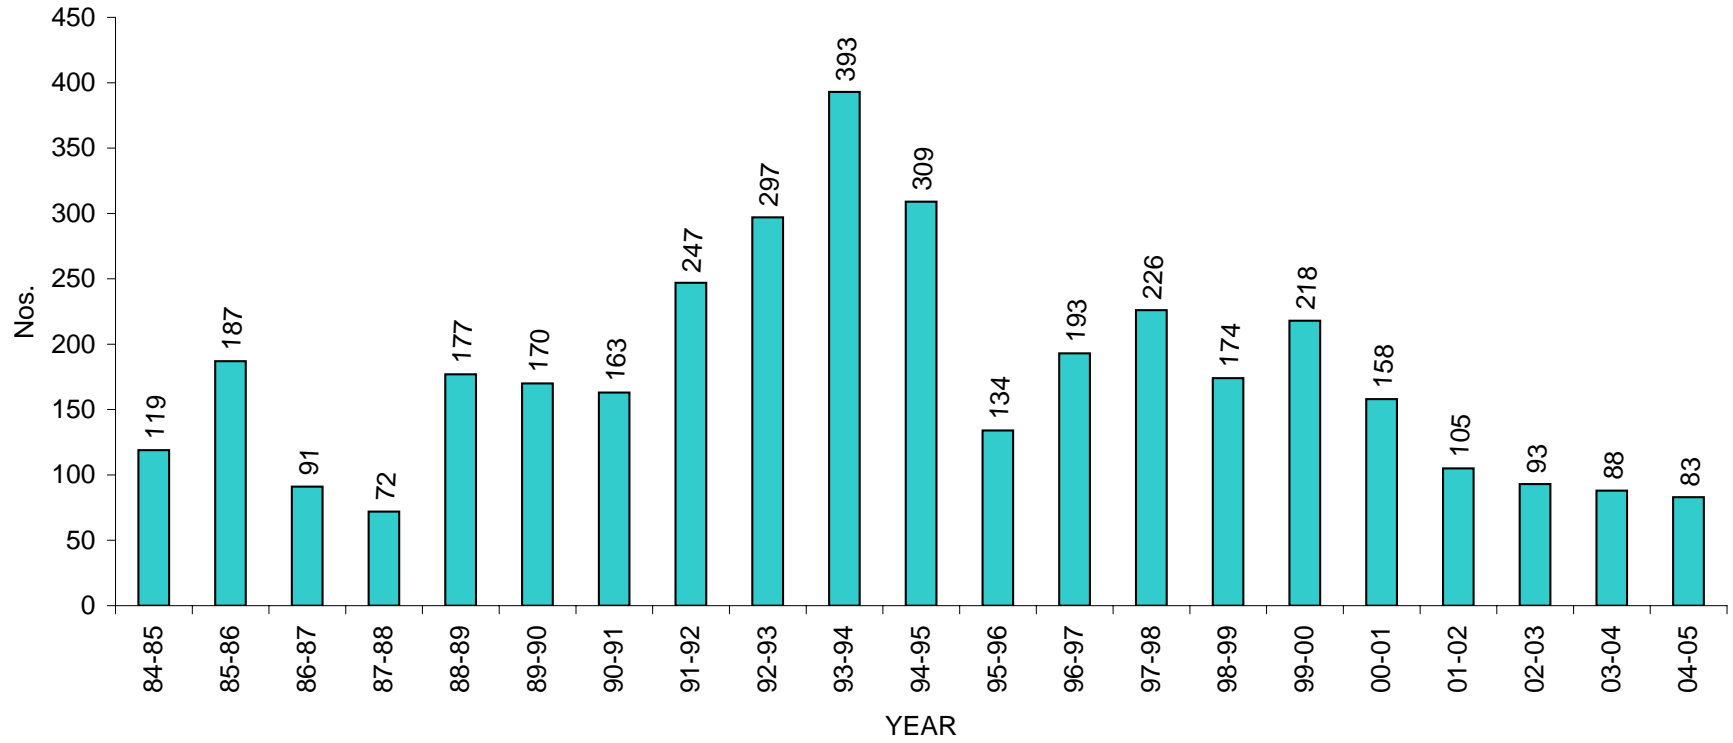


		DATE OF SYNCHRONISATION				PERFORMANCE DATA							Date of commercial run				
		UNIT-1	UNIT-4	UNIT-5	UNIT-6							UNIT-1	UNIT-4	UNIT-5	UNIT-6		
		26.09.84	29.03.85	29.03.89	30.03.93							10.01.85	01.10.85	25.09.88	01.08.89	29.09.92	14.12.93
YEAR	Gen.	Total	Spec.oil	Spec.coal	Auxiliary	DM Water	Thermal	Station	N.C.V.	No.of	PAF	Coal	Coal	PLF	Gen.Cost	Gen.Cost	
	Targets	Gen.	consump.	consump.	consump.	consump.	efficiency	Heat Rate		Trippings		receipt	consump.		gen. end	bus bar	
	MUs	MUs	MI/Kwh	Kg/kwh	%age	%age	%age	Kcal/kwh	Kcal/kwh	Nos.	%age	Lac.Tons	Lac. Tons	%age	paise/kwh	paise/kwh	
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05	
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33	
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93	
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27	
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69	
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99	
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28	
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77	
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35	
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01	
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83	
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07	
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08	
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75	
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52	
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61	
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65	
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73	
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31	
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00	
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12	

GGSSTP ROPAR
THERMAL EFFICIENCY %age

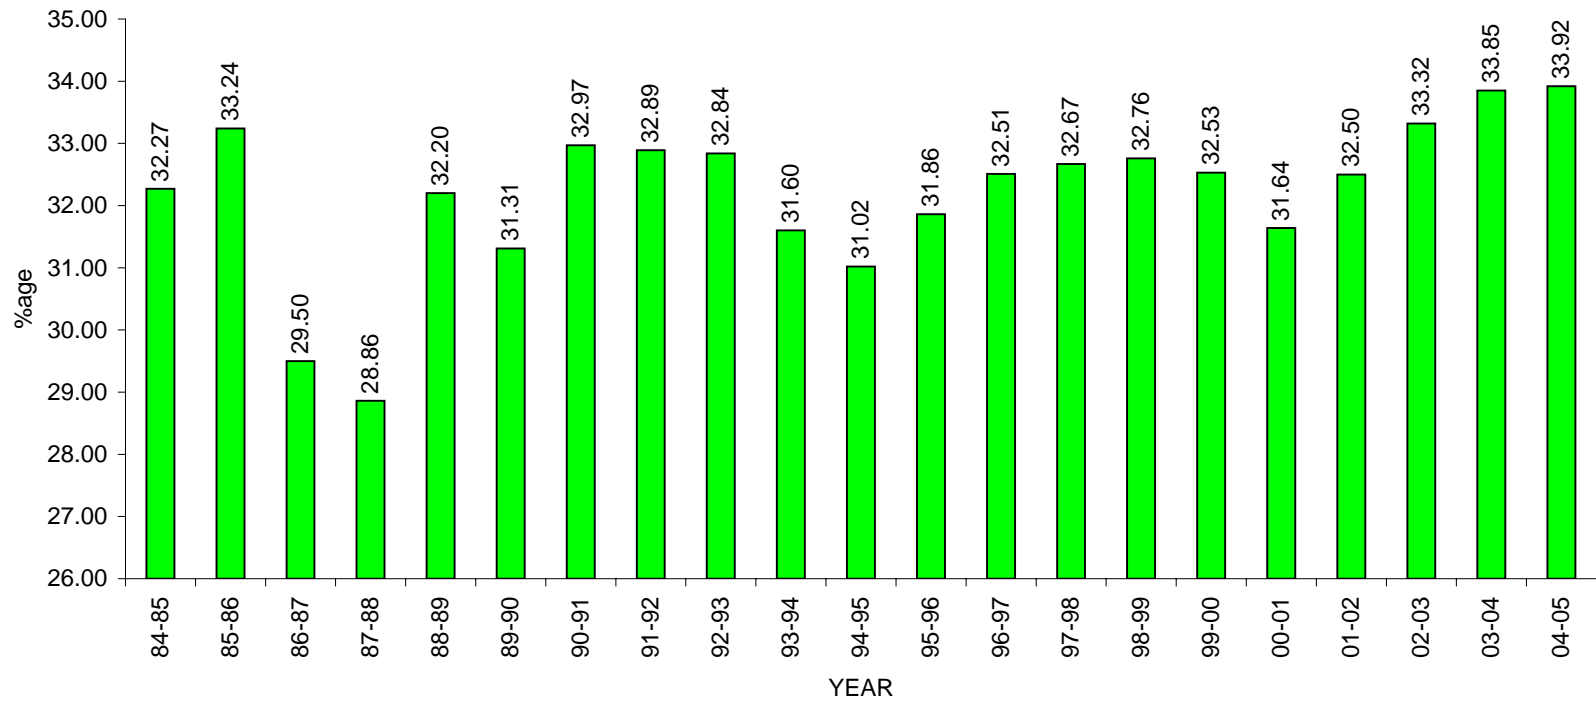


	DATE OF SYNCHRONISATION			PERFORMANCE DATA							Date of commercial run					
	UNIT-1	26.09.84	UNIT-4	29.01.89							UNIT-1	10.01.85	UNIT-4	01.08.89		
	UNIT-2	29.03.85	UNIT-5	29.03.89							UNIT-2	01.10.85	UNIT-5	29.09.92		
	UNIT-3	31.03.85	UNIT-6	30.03.93							UNIT-3	25.09.88	UNIT-6	14.12.93		
YEAR	Gen. Targets	Total Gen. MUs	Spec.oil consump. MI/Kwh	ec.coal consump. Kg/kwh	Auxiliary consump. %age	DM Water consump. %age	Thermal efficiency %age	Station Heat Rate Kcal/kwh	N.C.V. Kcal/kwh	No.of Trippings Nos.	PAF %age	Coal receipt ac.Tons	Coal consump. Lac. Tons	PLF %age	Gen.Cost gen. end paise/kwh	Gen.Cost bus bar paise/kwh
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12

GGSSTP ROPAR
DM WATER CONSUMPTION %age

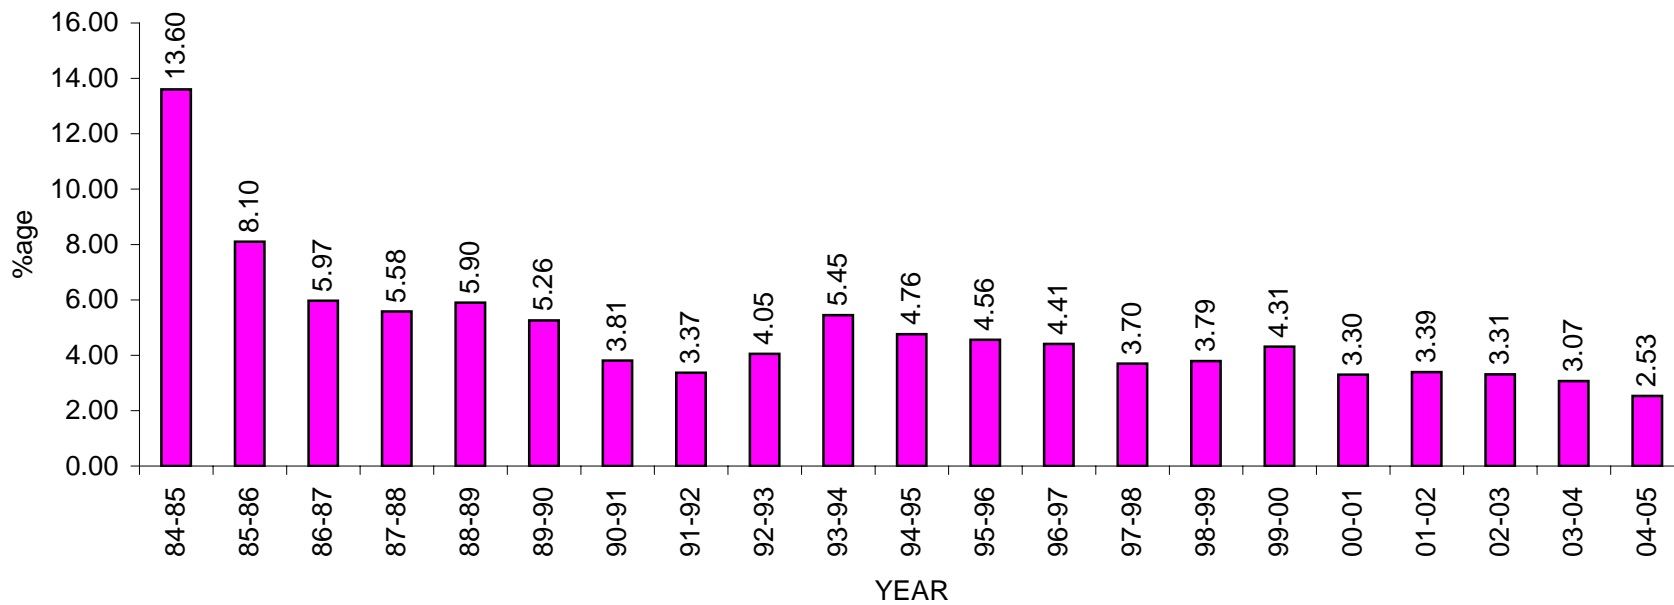

DATE OF SYNCHRONISATION				PERFORMANCE DATA							Date of commercial run					
UNIT-1	26.09.84	UNIT-4	29.01.89								UNIT-1	10.01.85	UNIT-4	01.08.89		
UNIT-2	29.03.85	UNIT-5	29.03.89								UNIT-2	01.10.85	UNIT-5	29.09.92		
UNIT-3	31.03.85	UNIT-6	30.03.93								UNIT-3	25.09.88	UNIT-6	14.12.93		
YEAR	Gen.	Total	Spec.oil	Spec.coal	Auxiliary	DM Water	Thermal	Station	N.C.V.	No.of	PAF	Coal	Coal	PLF	Gen.Cost	Gen.Cost
	Targets	Gen.	consump.	consump.	consump.	consump.	efficiency	Heat Rate		Trippings		receipt	consump.		gen. end	bus bar
	MUs	MUs	MI/Kwh	Kg/kwh	%age	%age	%age	Kcal/kwh	Kcal/kwh	Nos.	%age	Lac.Tons	Lac. Tons	%age	paise/kwh	paise/kwh
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12

GGSSTP ROPAR
AUXILIARY CONSUMPTION %age

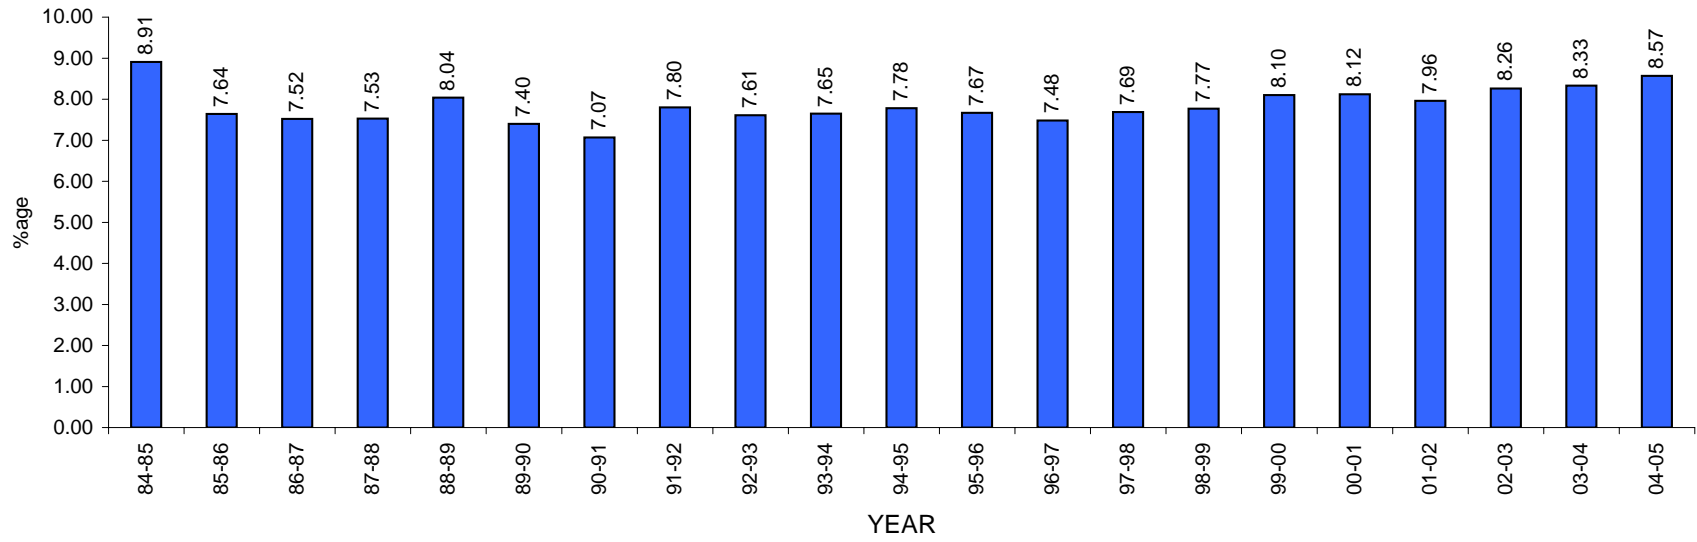

DATE OF SYNCHRONISATION				PERFORMANCE DATA								Date of commercial run				
UNIT-1	26.09.84	UNIT-4	29.01.89									UNIT-1	10.01.85	UNIT-4	01.08.89	
UNIT-2	29.03.85	UNIT-5	29.03.89									UNIT-2	01.10.85	UNIT-5	29.09.92	
UNIT-3	31.03.85	UNIT-6	30.03.93									UNIT-3	25.09.88	UNIT-6	14.12.93	
YEAR	Gen.	Total	Spec.oil	Spec.coal	Auxiliary	DM Water	Thermal	Station	N.C.V.	No.of	PAF	Coal	Coal	PLF	Gen.Cost	Gen.Cost
	Targets	Gen.	consump.	consump.	consump.	consump.	efficiency	Heat Rate		Trippings		receipt	consump.		gen. end	bus bar
	MUs	MUs	MI/Kwh	Kg/kwh	%age	%age	%age	Kcal/kwh	Kcal/kwh	Nos.	%age	Lac.Tons	Lac. Tons	%age	paise/kwh	paise/kwh
84-85	375.00	553.48	66.19	0.59	8.91	13.60	32.27	2664.47	3393.00	119	76.85	3.69	3.27	59.09	58.24	62.05
85-86	1820.00	1947.29	19.49	0.64	7.64	8.10	33.24	2586.46	3707.00	187	62.78	12.89	12.46	52.93	57.98	62.33
86-87	2500.00	2872.72	8.42	0.65	7.52	5.97	29.50	2896.46	4215.00	91	88.29	19.41	18.52	78.08	54.50	58.93
87-88	2600.00	2681.54	12.29	0.65	7.53	5.58	28.86	2918.20	4184.00	72	80.44	17.17	17.53	72.68	65.90	71.27
88-89	4000.00	2536.20	17.27	0.66	8.04	5.90	32.20	2670.83	3828.00	177	72.52	16.49	16.67	45.96	77.05	83.69
89-90	4670.00	3850.02	15.04	0.66	7.40	5.26	31.31	2746.47	3993.00	170	76.38	25.36	23.98	53.84	71.45	79.99
90-91	5200.00	3765.43	4.98	0.66	7.07	3.81	32.97	2608.45	3879.00	163	79.94	24.34	24.84	51.17	85.66	92.28
91-92	4800.00	4019.14	4.06	0.67	7.80	3.37	32.89	2614.59	3817.00	247	77.44	29.10	27.11	54.47	81.84	88.77
92-93	5200.00	4845.92	3.94	0.66	7.61	4.05	32.84	2625.00	3907.00	297	75.92	33.08	30.84	56.34	111.19	120.35
93-94	6500.00	6126.16	4.14	0.72	7.65	5.45	31.60	2721.81	3732.00	393	74.64	43.28	42.38	60.57	135.77	147.01
94-95	7500.00	6003.74	7.41	0.72	7.78	4.76	31.02	2772.32	3734.00	309	81.08	42.83	43.38	54.39	140.01	151.83
95-96	6740.00	6163.21	4.54	0.69	7.67	4.56	31.86	2699.19	3842.00	134	88.98	42.35	42.57	55.68	158.52	171.07
96-97	7000.00	7175.01	4.10	0.68	7.48	4.41	32.51	2645.27	3843.51	193	85.89	50.02	48.61	65.00	158.28	171.08
97-98	7765.00	7764.24	1.62	0.67	7.69	3.70	32.67	2632.07	3876.00	226	85.42	55.79	52.40	70.34	161.31	174.75
98-99	7356.00	7728.16	1.22	0.67	7.77	3.79	32.76	2625.27	3914.00	174	79.97	48.67	51.59	70.01	170.18	184.52
99-00	7483.00	8203.43	2.02	0.67	8.10	4.31	32.53	2643.91	3923.00	218	80.86	57.23	54.86	74.11	170.88	185.61
00-01	8400.00	8436.56	1.95	0.70	8.12	3.30	31.64	2718.03	3842.00	158	80.99	58.04	59.26	76.43	165.06	179.65
01-02	8450.00	8856.06	1.37	0.67	7.96	3.39	32.50	2646.56	3951.00	105	88.14	60.11	59.02	80.23	172.77	187.73
02-03	8500.00	8245.65	1.28	0.660	8.26	3.31	33.32	2581.06	3908.10	93	87.00	53.16	54.18	74.70	173.67	189.31
03-04	8649.00	8303.75	0.91	0.661	8.33	3.07	33.85	2540.47	3825.00	88	87.74	54.91	54.95	75.02	165.43	180.00
04-05	8895.00	9082.68	0.97	0.66	8.57	2.53	33.92	2535.71	3825.00	83	88.95	62.98	59.88	82.28	170.17	186.12

GGSSSTP ROPAR
SPECIFIC OIL CONSUMPTION MI/Kwh

